




LPG Tank Setbacks (Above Ground Tanks)

INFORMATIONAL
BULLETIN
FM-01

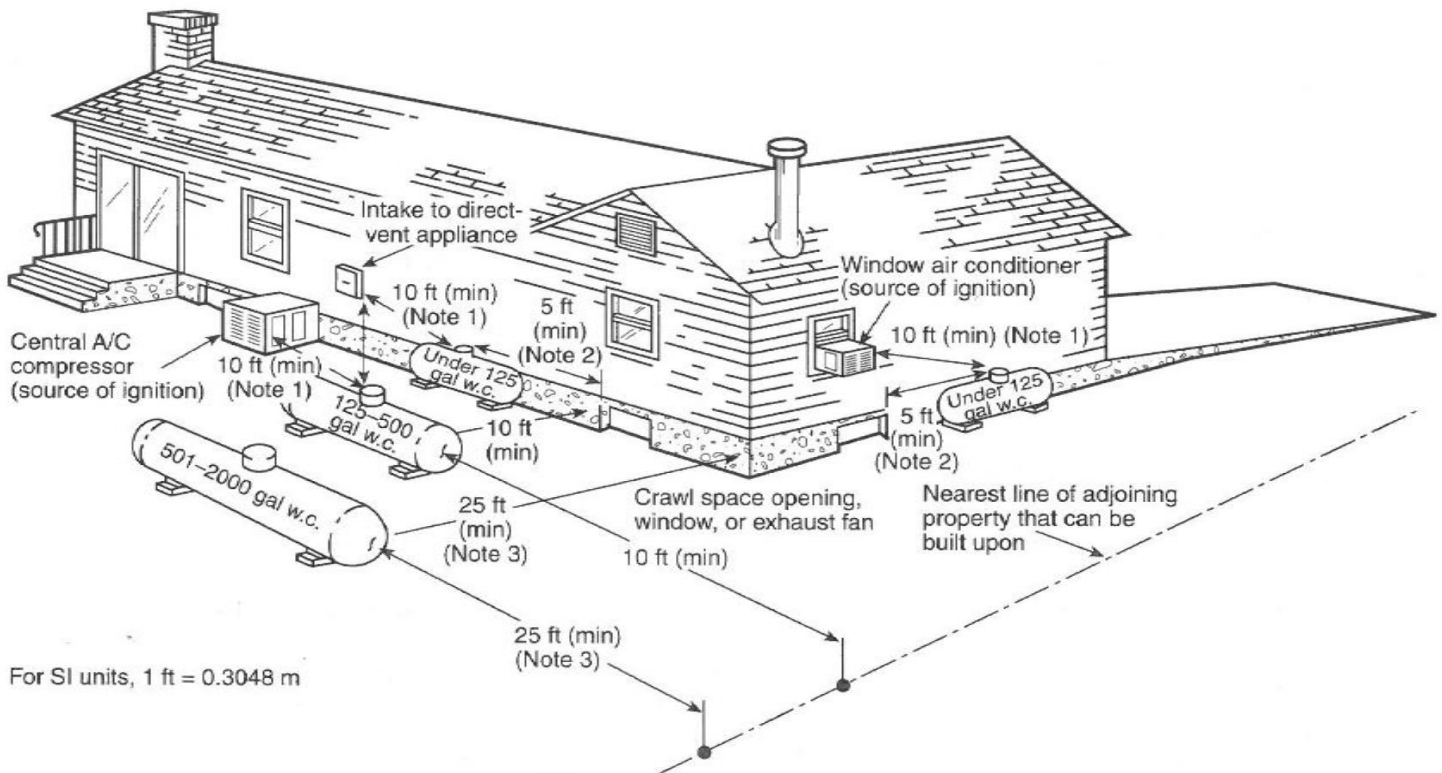

Note 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system. Refer to 6.3.9.

Note 2: Refer to 6.3.9.

Note 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m³) water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m³) water capacity. Refer to 6.3.3.

How do I schedule an inspection?

You may schedule an inspection by:

1. Call the City of Roslyn at (509) 649-3105 and request an LPG inspection.


The City of Roslyn inspects exterior gas piping and tank assemblies as well as all piping and appliance inspections on the interior of the structure.

(SEE REVERSE SIDE FOR UNDERGROUND TANK SETBACKS)



LPG Tank Setbacks (Underground Tanks)

INFORMATIONAL
BULLETIN
FM-01

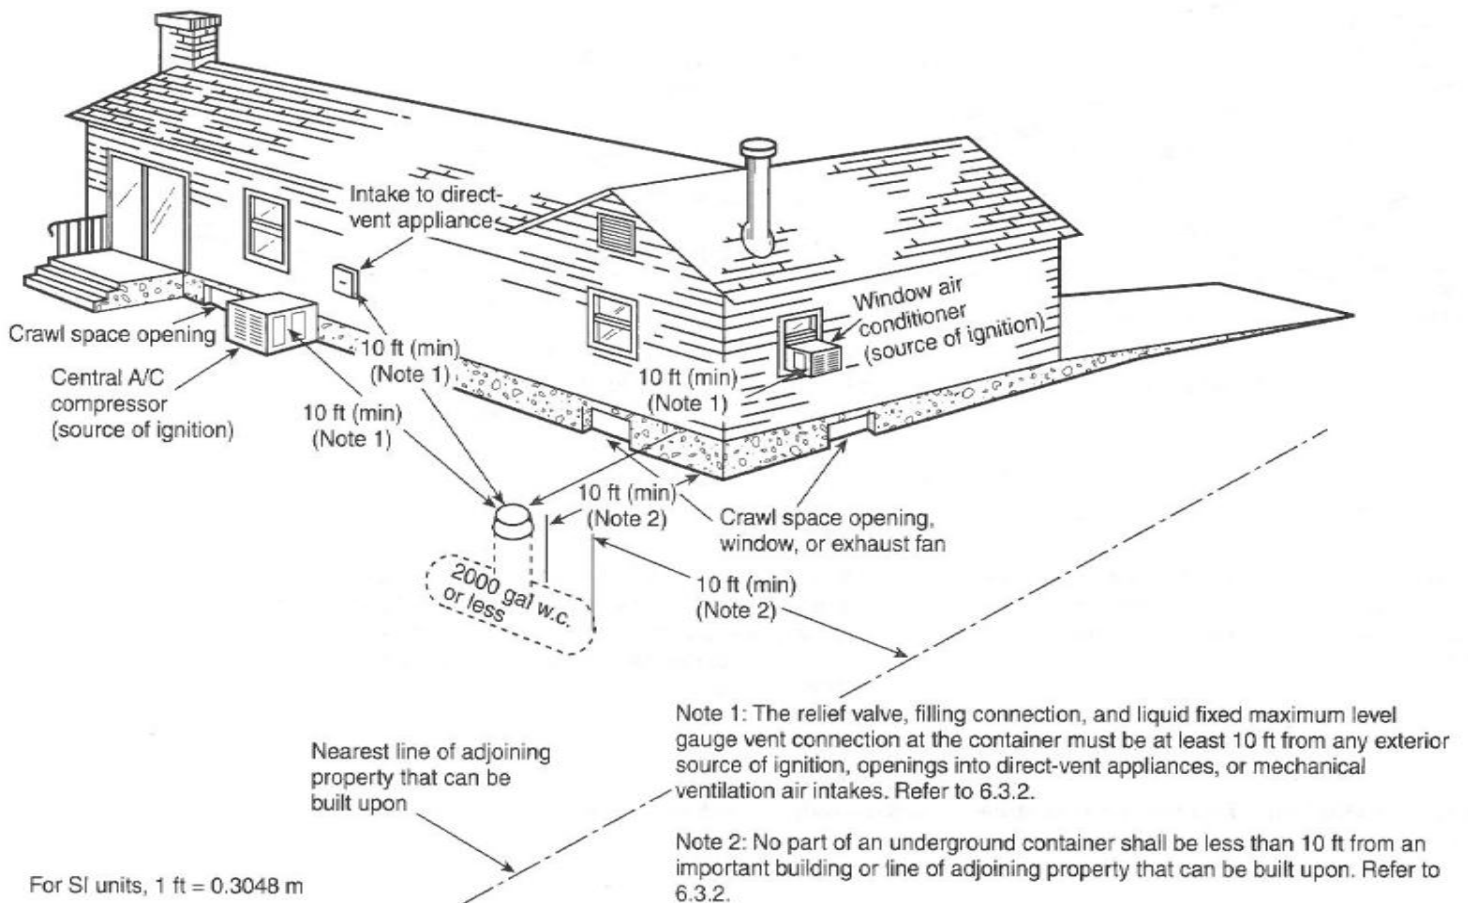

How do I schedule an inspection?

You may schedule an inspection by:

1. Call the City of Roslyn at (509) 649-3105 and request an LPG Inspection.

The City of Roslyn inspects exterior gas piping and tank assemblies as well as all piping and appliance inspections on the interior of the structure.

(SEE REVERSE SIDE FOR ABOVE GROUND TANK SETBACKS)